

welldana®



pool spa sauna wellness

Welldana A/S

Randersvej 6 · DK-6700 Esbjerg

Phone +45 75 27 23 33

Fax +45 75 27 21 11

E-mail: info@welldana.com

www.welldana.com

Installationsvejledning Udluftningsventil type 75-100103.



Udluftningsventil til solpanel.

Udgave 1.1 10 - 2005.

Language  & 

1. Tekniske data.


Tekniske specifikationer.	
Max. tryk.	16 bar.
Tilslutning.	½" & 50 mm.
Snavsfilter.	Ja.
Medie.	Vand.
Dobbeltvirkende.	Ja.
Materiale.	Messing & PVC.

Udluftningsventilen leveres med 50mm. adapter som passer til gummi muffen type 75-500101 til Soladur® solpaneler.
Leveres uden spændebånd.



2. Installation princip.

Udluftningsventilen skal monteres på det højeste sted på panelet.

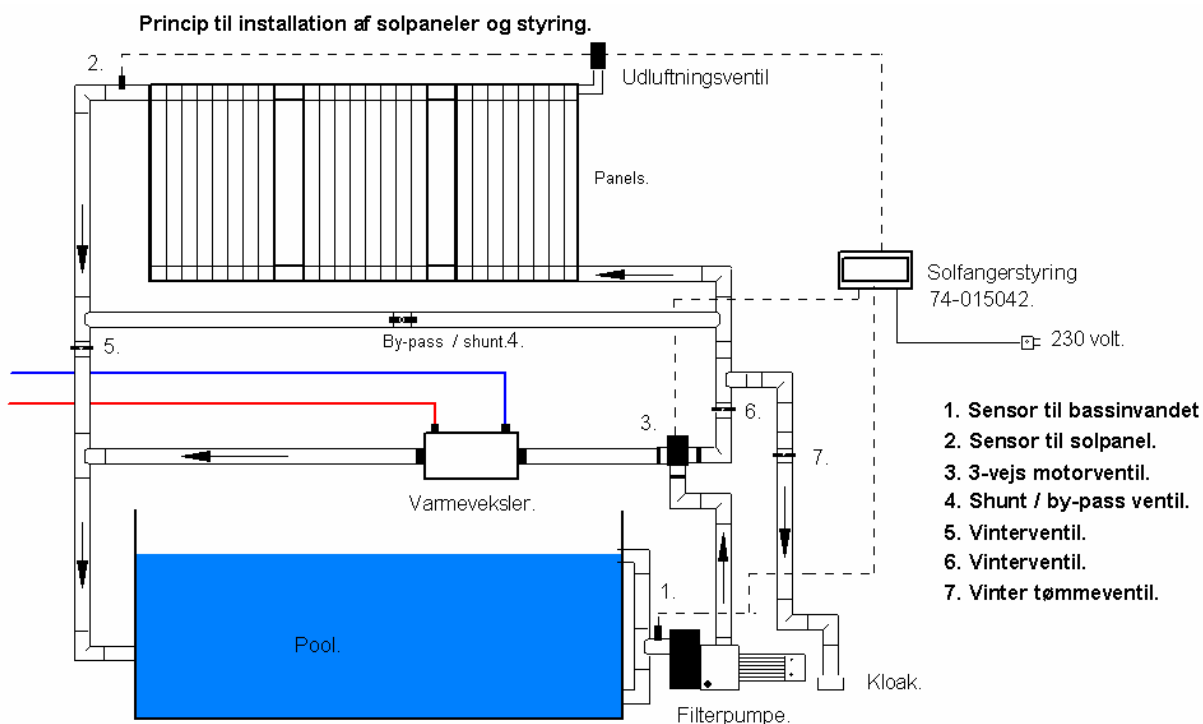



Installation manual Aut. Airing valve. type 75-100103.



Airing valve for sunpanels.

1. Technical data.

Technical specifications.	
Max. pressure.	16 bar. / 232 PSI
Conection.	½" & 50 mm.
Dirtfilter.	Yes.
Medie.	Vand.
Double-acting.	Yes.
Material.	Brass & PVC.

The Airing valve comes with an adapter in 50mm. which fits the connection adapter type 75-500101 for the Solar® panels.
The hose clips are not include.



2. Installation principal.

The Airing valve has to be installed on the highest point.

